NOTES:

1. For planning only, not for construction.
2. All dimensions in millimeters unless otherwise stated.
3. Co-ordinates are to Irish Transverse Mercator (ITM).
4. This is an indicative typical drawing subject to detailed design.

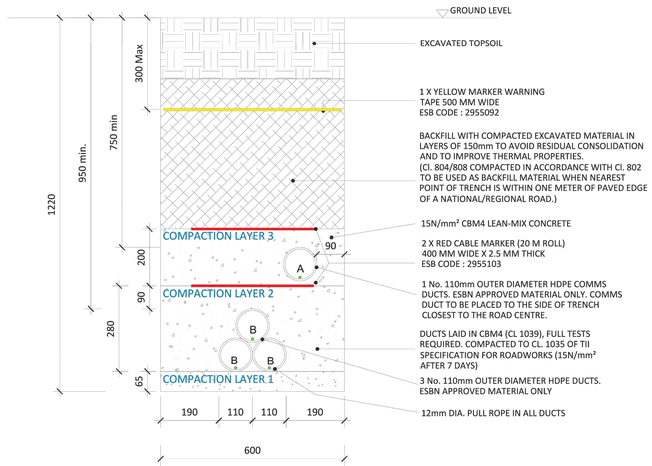

A =110mm:Outer diameter HDPE ESB Approved Duct, SDR=17.6;

B =110mm:Outer diameter HDPE ESB Approved Duct, SDR=17.6;

TYPICAL SECTION THROUGH OFF ROAD / GRASSLAND

Scale 1:10

Reinstatement details based on Guidelines for Managing Openings in Public Roads - SD4

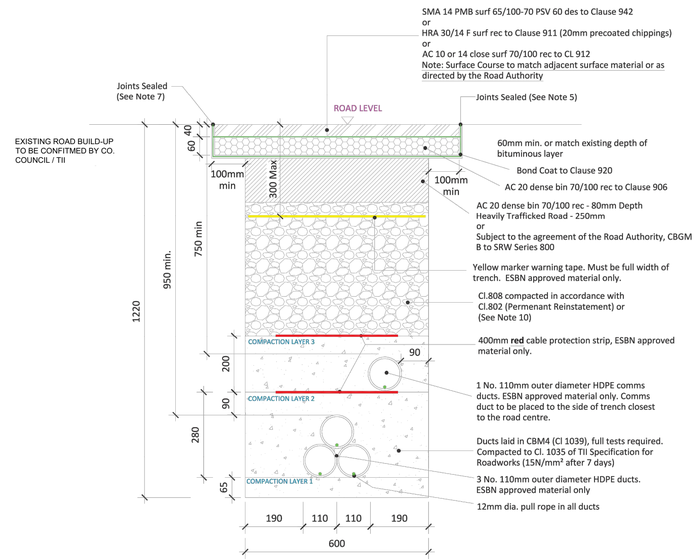

TYPICAL SECTION THROUGH CABLE TRENCH IN PUBLIC ROADS

Scale 1:10

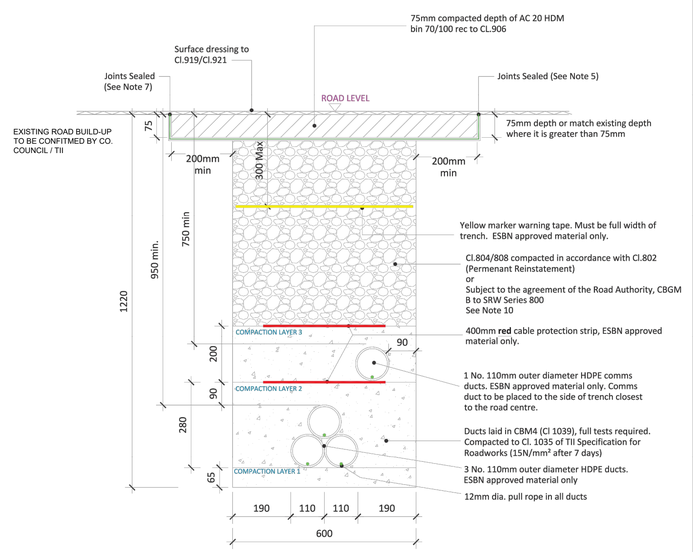

TYPICAL SECTION THROUGH CABLE TRENCH IN UNBOUND ROADS

Scale 1:10

If Applicable : Ordnance Survey Ireland Licence No. CYAL50221678 © Ordnance Survey Ireland and Government of Ireland

FEHILY TIMONEY

Cork | Dublin | Carlow

www.fehilytimoney.ie

No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Fehily Timoney & Company as copyright holder except as agreed for use on the project for which the document was originally issued. Do not scale. Use figured dimensions only. If in doubt - Ask!

Rev.	Description	App By	Date
P01	FOR PLANNING	JH	19.09.24

PROJECT	BALLYNAHONE LONG DURATION ENERGY STORAGE
CLIENT	FUTURENERGY IRELAND DEVELOPMENT DAC
SHEET	CABLE TRENCH TYPICAL DETAILS
Date	19.09.24
Project number	P23-117
Scale (@ A1)	As Shown
Drawn by	POR
Checked by	TB
Drawing Number	P23-117-0300-0002
Rev	P01

O:\ACAD\2023\P23-117\P23-117-0300-0002

Friday 20 September 2024